



Datasheet



0370 330 6021

www.sunbeltrentals.co.uk

PTE-50-CET

*Three phase relay test set
Current/Voltage*



SMC
EURO

PTE-50-CET

MAIN FEATURES

- Variable three phase Current up to 3 x 50A or Voltage up to 3 x 150V.
- Variable phase angle between 0 - 359.9° (Single or three phase).
- Harmonic selection independent by phase, up to the 7th harmonic.
- Output power: 3 x 100VA.
- Reversible outputs.
- Outputs are fully isolated and electronic.
- Dynamic capability.
- Completely programmable.
- Built-in Timer, 1ms resolution.
- Dimensions: 200 x 442 x 327 mm/ 25 Kg
8 x 18 x 13 in./ 52 lb.



APPLICATIONS

- Testing of three phase motor protection relays.
- Testing of three and single phase overcurrent and differential protection relays.
- Can be used as a complete single phase unit in voltage, current, and phase as outputs are reversible (V, I, φ).

DESCRIPTION

The PTE-50-CET equipment is a universal, portable, test system with three outputs to test single and three phase protective relays.

The equipment comprises of three independent output channels that can be selected as current or voltage. This enables the unit to be used as a complete single-phase equipment (voltage, current, and phase angle between them) or, with channels synchronised, as a three phase current or three phase voltage generator from a single phase mains input.

The unit is extremely compact and rugged. The design incorporates the latest in modern digital microprocessor technology to achieve unbeatable output characteristics in terms of power, accuracy, low distortion, and dynamic capability. This technology allows users to test many different specific functions required in relay testing, without the need of additional accessories.

All output signals are digitally generated, amplified, and internally controlled by the IGM's (Intelligent Generator Modules), which interpret the orders received from the front panel to produce a highly accurate, stable, and low distorted output, independent of the voltage supply.

The equipment also allows optional connection to a computer for either automatic testing of relays or control of the equipment using Windows compatible software.

Even the adjustment and calibration of the equipment is made by software, supplied with the units, which permits calibration and/or adjustments in the outputs, without any manual hardware setting. (Closed Case Calibration)

In summary, the PTE-50-CET is an equipment which offers all the characteristics and functions needed for protective relay testing, in a manual or automatic mode, and in laboratory and/or for on site testing.



FEATURES

The PTE-50-CET was designed as a unit able to test relay applications which do not require three-phase voltage and three phase currents at the same time. This is generally the situation in relays installed in distribution or in medium voltage installations.

Obviously there is a wide range of relay types and relay functions in this scenario, such as Overcurrent, Directional, Motor Protection, Differentials, etc. Not only can these types of relays be found, but also the generations of relays designs (Electromechanical, Electronic, and Digital) which all need to be tested.

Each relay designs demands differing requirements of the testing equipment, not only related to power and accuracy, (which normally determines the selected tester), but also design concepts. Design concepts such as various control modes, size, modularity, etc. properly developed can notably improve the application of the equipment.

In the following sections are the details which makes the PTE-50-CET your practical choice above all the other test equipment in the market.

USER FLEXIBILITY

Any type of test equipment should be flexible in a way that it should perfectly preform and adapt from one relay test to another. Thus the PTE-50-CET offers complete flexibility:

- *Due to the Reversible channels of current and voltage, the unit can be use as a stand-alone unit for single phase testing.*
- *Can be combined to operate with any other equipment from the PTE range, or other complementary equipment even to any other relay test equipment from any other manufacture.*

MANUAL CONTROL

The need for a manual control mode, even when testing the most sophisticated relay, lies at the core of efficient testing. Particularly during commissioning work, the major part of the tests are not systematic, but depend on the installation and the functions assigned to the relay under test. This implies that the manual control must be intuitive, easy to use, understandable by any operator, without the need of special training and without the need of any external elements from the system. This and other functions are included in the PTE-50-CET.

The following describes these features:

- *The manual controls are clearly arranged for the user. There is a control step-knob beside the display of each parameter, whether it is output level or phase angle, which sets the display value in real time.*
- *A single control step-knob can simultaneously change values in one or more channels. This allows, for example, the use of paralleled channels as if there were one, with greater power and reach.*

- *Programming pre-fault and fault conditions, either as a single parameter change or by changing all available outputs at the same time (3 output channels in current or voltage)*
- *Total system status display enables the user to view outputs status, alarms, monitor signals, phase angle, etc. in real time.*



REVERSIBLE OUTPUTS

The three channels of the PTE-50-CET are reversible in their function, this means that they can be used either as current or voltage generators completely independent from each other. This provides applications as follows:

- *Up to 3 Currents or 3 Voltages are available simultaneously.*
- *Converts the PTE-50-CET into a complete single-phase unit in voltage and current with their corresponding phase angle.*
- *Numerous combinations of voltage and current in the three channels are available.*
- *Creating outputs by linking channels with identical parameters to sum the power and reach available*

The PTE-50-CET unit permits the connection of all outputs in parallel, which practically covers all the secondary relay testing requirements. The following are the output ranges that can be obtained.

- 0 - 1 A 150 V max.
- 0 - 24 A 12.5 V max.
- 0 - 75 A 4 V max.
- 0 - 150 A 2 V max.



PTE-50-CET

1 RS-232 COM PORT

User to control and communicate with external hardware to perform the following:

- Connected to a computer
 - Calibration and default values
 - Automatic testing and fault simulation.
- Connection to a printer to directly print test results.

2 PTE-BUS

Allows the interconnection with any other unit in the PTE RANGE, allowing an easy access for references, controls, etc.

3 EVENT OUTPUT

Normally used to start an external timer, this output produces a voltage free, closed contact type pulse with a 20ms duration each time the ON/OFF key or any of the step to 2nd value keys are pressed on the front panel.

4 BUILT-IN TIMER

The built-in timer can measure the time delay of the Relays under test with a 1ms resolution. It is a digital timer incorporated in the PTE-50-CET and contains all the required inputs and outputs to start and stop the timer whether by the signal monitors or via the BUS-PTE.

5 POWER OUTPUTS

There are three output channels, that can operate simultaneously or independently. Each Channel may be used in Voltage or Current mode up to 50 A in 4 ranges or 150 V in 2 ranges.

All output regulation including the phase angle can be independent by phase, or linked in a three-phase regulation, all linked channels can be changed simultaneously.

Any combination of voltage and current channels can be selected.

All the outputs have a Dynamic Capability, which means that any combination of Dynamic steps to 2nd. values, can be selected in amplitudes and phase angles. This Dynamic capability can work independently in each channel or linked in a three-phase system, in a way which allows for an easy and flexible method to preform any type of fault simulation.

6 INTERNAL HARMONICS GENERATOR

In the unit PTE-50-CET, it is possible to select any Harmonic of the fundamental or reference Frequency. The 1st, 2nd, 3rd, 4th, 5th, 6th and 7th harmonic can be selected. These Harmonics can be different in each Output Channel. By paralleling the three outputs, any combination of Harmonics can be easily obtained.





7 **SELECTABLE REFERENCES**

The power outputs can be synchronized to three different references in both frequency and phase.

- The main supply phase (Line).
- The BUS-PTE, when working with other PTE equipment (Bus).
- External Phase Reference (Ext).

8 **MASTER/SLAVE CONTROL**

Enables the controls of two or more channels, such as outputs ON/OFF and change to a 2nd value to be used by one control.

9 **MAINS VOLTAGE SUPPLY**

The voltage is supplied to the equipment by a standard SCHUKO male plug with ground. Contain in this is a main filter to eliminate possible perturbations from entering the equipment. Standard 5 x 20 mm. fuses protects the input circuits.

10 **AUXILIARY VOLTAGE OUTPUT**

The auxiliary voltage output has a nominal voltage of 110V ac with a maximum current of 0.3 A. This output is fuse protected.

11 **SIGNAL MONITOR**

The signal monitor informs the state of the relay under tests. These inputs can work with Dry Contacts (voltage free) or with Voltage Signals from 5 to 250 V ac or dc. There are two monitors.

12 **OUTPUTS PROTECTION**

The outputs and the unit are electronically protected against overload, short-circuit and over temperature. The appropriate alarm is indicated on the front panel, as well as the channel where it occurs. The outputs are fuse protected.

13 **EXTERNAL REFERENCE INPUT**

The equipment can be synchronized, in terms of frequency and phase, with any external signal from 0.1 to 25A or in voltage from 5 to 300V.

This feature enables the equipment to work with any other test equipment.

SERIAL CONNECTION CAPABILITY

The PTE-50-CET outputs can be serial connected, thus expanding the maximum voltage output.

This is an optional feature and is supplied with 3 serial plugs to enable various voltage ranges.

The serial plugs are easily installed when required and are designed to avoid any misconnection.

This serial option can be used when the equipment is used manually or by software control with the EUROTEST software.

The following ranges can be obtained:

• Plug 1	0.33 A	450 V
	8 A	37 V
	25 A	12 V
• Plug 2	50 A	6 V
	0.33 A	300 V
• Plug 3	8 A	25 V
	25 A	8 V


INTERCONNECTION CAPABILITY

By simply connecting a cable via the BUS-PTE, the PTE-50-CET can be interconnected to any other equipment in the PTE range, including another PTE-50-CET. This capability widens the application scope of the PTE units as combinations of units can be made to match the requirements of the relay. An example is our three phase system TRES.

Furthermore incorporated in the PTE-50-CET is a frequency and phase external reference that allows interconnection with other test equipment including relay test equipment from other manufacturers.

STANDARD ACCESSORIES

- Instruction Manual.
- 1 Voltage supply cable with earth, 1.5 m length.
- 4 Connection Adapters, 4 mm / Flat Terminal.
- 12 Crocodile clips, input 4 mm.
- 9 Connection Cables, 2.5 mm section 2 meters length.
- 1 RS-232 Cable.
- 2 BNC cables with Banana terminals, 4 mm.
- 1 Interconnection Cable BUS-PTE.
- Complete set of fuses.
- Nylon protection bag.

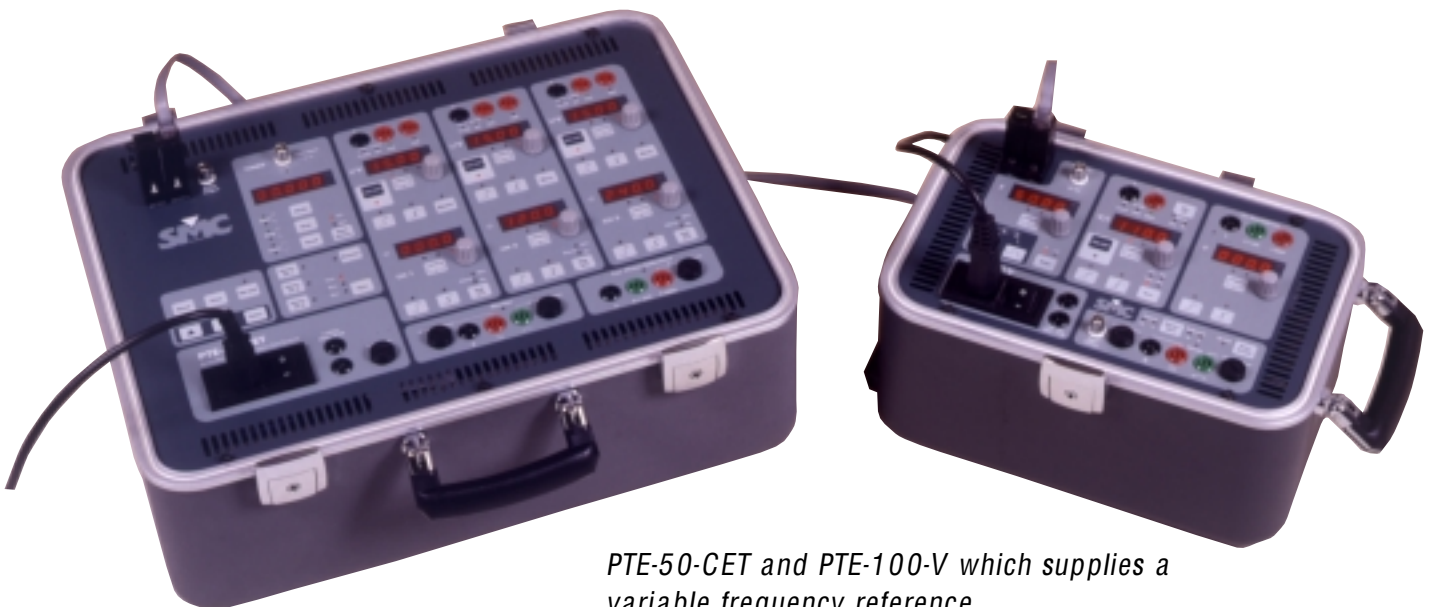


PTE-50-CET and PTE-100-V which supplies a variable frequency reference.

COMPUTER CONTROL


The PTE-50-CET can be completely controlled by an external computer, along with its corresponding software programs. The PTE-50-CET uses the PTE-12 adapter, which connects to the RS 232 serial port of the computer to the BUS-PTE port on the unit.

The corresponding software of the PTE-50-CET is divided in various packages and optional programs to suit a variety of application use. These are:

- **EUROTEST ERTST-3I.** This software enables automatic and systematic tests routines, with standard routine tests for each type of relays. There is also a library of routine tests supplied with the software. These can easily be edited to adapt to the application desired or the user can create new routines.

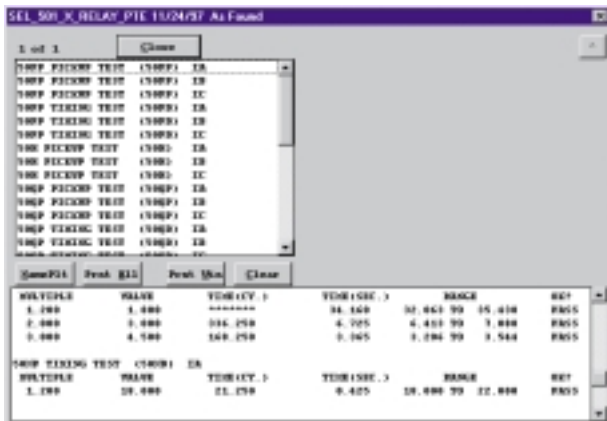

- **EUROFAULT.** Enables the playback of any previously registered or calculated fault in COMTRADE format. The bandwidth is between 0.5 and 5000 Hz.

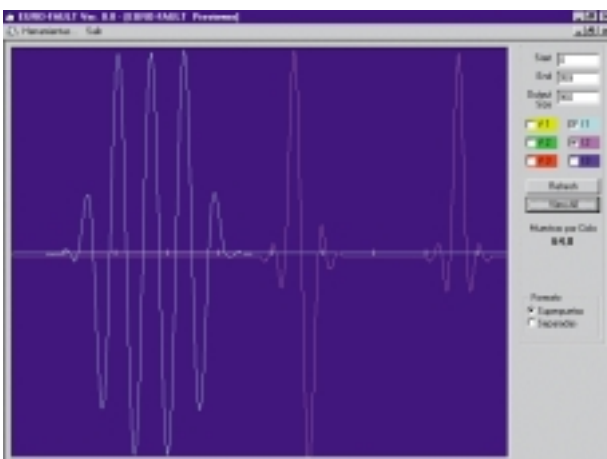

OPTIONAL ACCESSORIES

BATTERY SIMULATOR (PTE-FCG)

An auxiliary DC voltage supply, which is needed for the majority of relays, the PTE-FCG has fixed outputs of 48, 125 o 250 V dc with 60 W in each output. This can be incorporated in the top lid of the PTE equipment.




INTERFACE RS-232/BUS-PTE (PTE-12)

Acts as the interface between the RS-232 serial port of the computer and the BUS-PTE. Includes all the adapters and cables required, along with the control command manual, PTE COM.



- **PTE-CAL.** Enables the adjustment and calibration of the unit, without the need of any intervention inside the equipment (Closed Case Calibration).

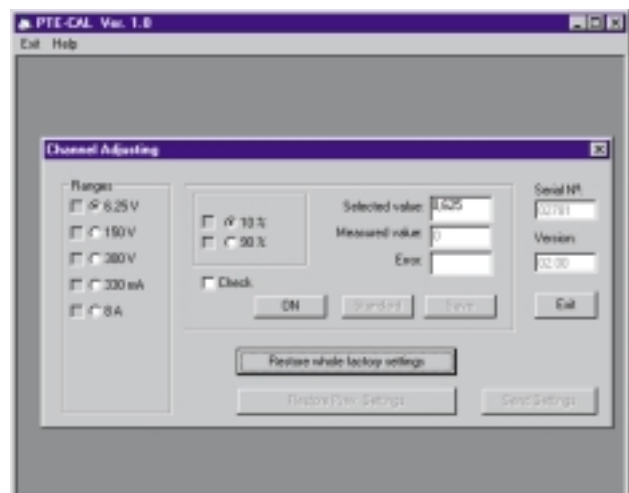

TECHNICAL SPECIFICATION

POWER OUTPUT (Each channel)

MODE	RANGES		Permanent Current	Permanent Voltage	Accuracy	Maximum Distortion	Permanent Power
	LEVEL	RESOLUTION					
CURRENT	0 - 0.330A	0.001 - 0.01 - 0.1A	-	150V	± 0.5%	1%	100VA
	0 - 8.000A	0.001 - 0.01 - 0.1A	-	12.5V			
	0 - 25.00A	0.01 - 0.1 - 1A	-	4V			
	0 - 50.00A	0.01 - 0.1 - 1A	-	2V			
VOLTAGE	0 - 150V	0.1 - 1 - 10V	0.33A	-	±0.5%	1%	100VA
	0 - 6.25V	0.01 - 0.1 - 1V	8A	-			
PHASE ANGLE	0 - 359.9°	0.1 - 1 - 10°	-	-	± 0.5°	-	-

TRANSIENT BANDWIDTH: 0.5 - 5000 Hz

BUILT-IN TIMER

MEASURING RANGES:	Time:	0.001 to 99999 s. (autorange).
	Cycles:	000.1 to 9999.9 Cycles (referenced frequency).
ACCURACY:	±0.003% of the reading ±1 dig.	
TIMER START:	Internal Events:	<ul style="list-style-type: none"> • By activation/deactivation of the power output. • By activation/deactivation of the change to 2nd value key.
	External Events:	<ul style="list-style-type: none"> • By a positive or negative event in the BUS-PTE. • By activation/deactivation of the external signal input.
TIMER STOP:	<ul style="list-style-type: none"> • Selectable between activation or deactivation of the Signal Monitor. 	
	<ul style="list-style-type: none"> • By a positive or negative event in the BUS-PTE. 	

EXTERNAL REFERENCE INPUT

MODE	SIGNAL RANGE	FREQUENCY RANGE	INPUT IMPEDANCE
VOLTAGE	5 - 300 V	40 - 70 Hz	47 KΩ
CURRENT	0.1 - 25 A	40 - 70 Hz	25 mΩ

INTERNAL HARMONICS GENERATOR

HARMONICS AVAILABLE:	1st, 2nd, 3rd, 4th, 5th, 6th and 7th of the reference frequency up to 420 Hz.
ACCURACY:	±0.003 Hz.
SELECTION:	The different harmonics can be easily selected and are completely independent by channel.

DIGITAL CONTROL OUTPUT

Maximum AC Voltage:	20 V
Maximum DC Voltage:	± 28 V
Maximum AC/DC Current:	0.5 A
AC Power:	10 VA
DC Power:	14 W

SIGNAL MONITOR

(there are two signal monitors, M1 y M2)

Dry Contact Input (Monitors M1 and M2)
<ul style="list-style-type: none"> • Open circuit voltage: 10.2 V. D.C. • Short-circuit current: 25 mA • Fuse protected.
Voltage input (Monitors M2)
<ul style="list-style-type: none"> • Level Limits: From 5 to 250 V A.C./D.C. • Input Impedance: 19 KΩ • Fuse protected.

GENERAL

Auxiliary Voltage Output:	NomV: 115 Vac/MaxI: 0.3 Aac/Fuse protected
Temperature Range:	Operation: 0 - 50° C /Storing: -20° - 70° C
Voltage supply:	230 V ± 10% (Standard version) 50-60 Hz 115 V ± 10% (upon request) 60 Hz.
Dimensions:	Height: 200 mm Width: 442 mm Depth: 327 mm
Weight:	25 Kg. - 52 lb.

DISTRIBUTED BY:

EUROSMC, S.A.

Polígono Industrial P-29, Calle Buril, 69. 28400 Collado-Villalba. Madrid (Spain). Tels: 34 - 91 - 849 89 80*. Fax: 34 - 91 - 851 25 53
www.eurosmc.com • e-mail: sales@eurosmc.com

We are supporting you to deliver
a world class service, every day,
in every sector...

LOCATIONS

LONDON, HEATHROW

Sunbelt Rentals UK Test & Monitoring

242-252 London Road, Staines, London TW18 4JQ

0333 122 3126

www.sunbeltrentals.co.uk/find-a-depot/london-heathrow

REDCAR

Sunbelt Rentals UK Test & Monitoring

Unit 5 Kirkleatham Business Park, Redcar TS10 5SQ

0370 330 6021

www.sunbeltrentals.co.uk/find-a-depot/teeside

STOKESLEY

Sunbelt Rentals UK Test & Monitoring

2 Ellerbeck Way, Stokesley Business Park, Stokesley, North Yorkshire TS9 5JZ

01642 718 900

www.sunbeltrentals.co.uk/find-a-depot/stokesley



www.inlec.com

Order Online with Next Day
Delivery, Online Chat & Online
Account Management



★ Trustpilot

View our trustpilot score



STOKESLEY  REDCAR

 HEATHROW

0370 330 6021

instrumentation@sunbeltrentals.co.uk

testequipment@sunbeltrentals.co.uk

www.sunbeltrentals.co.uk

